



Map 5.7 Nitrates, Atrazine & Groundwater Protection

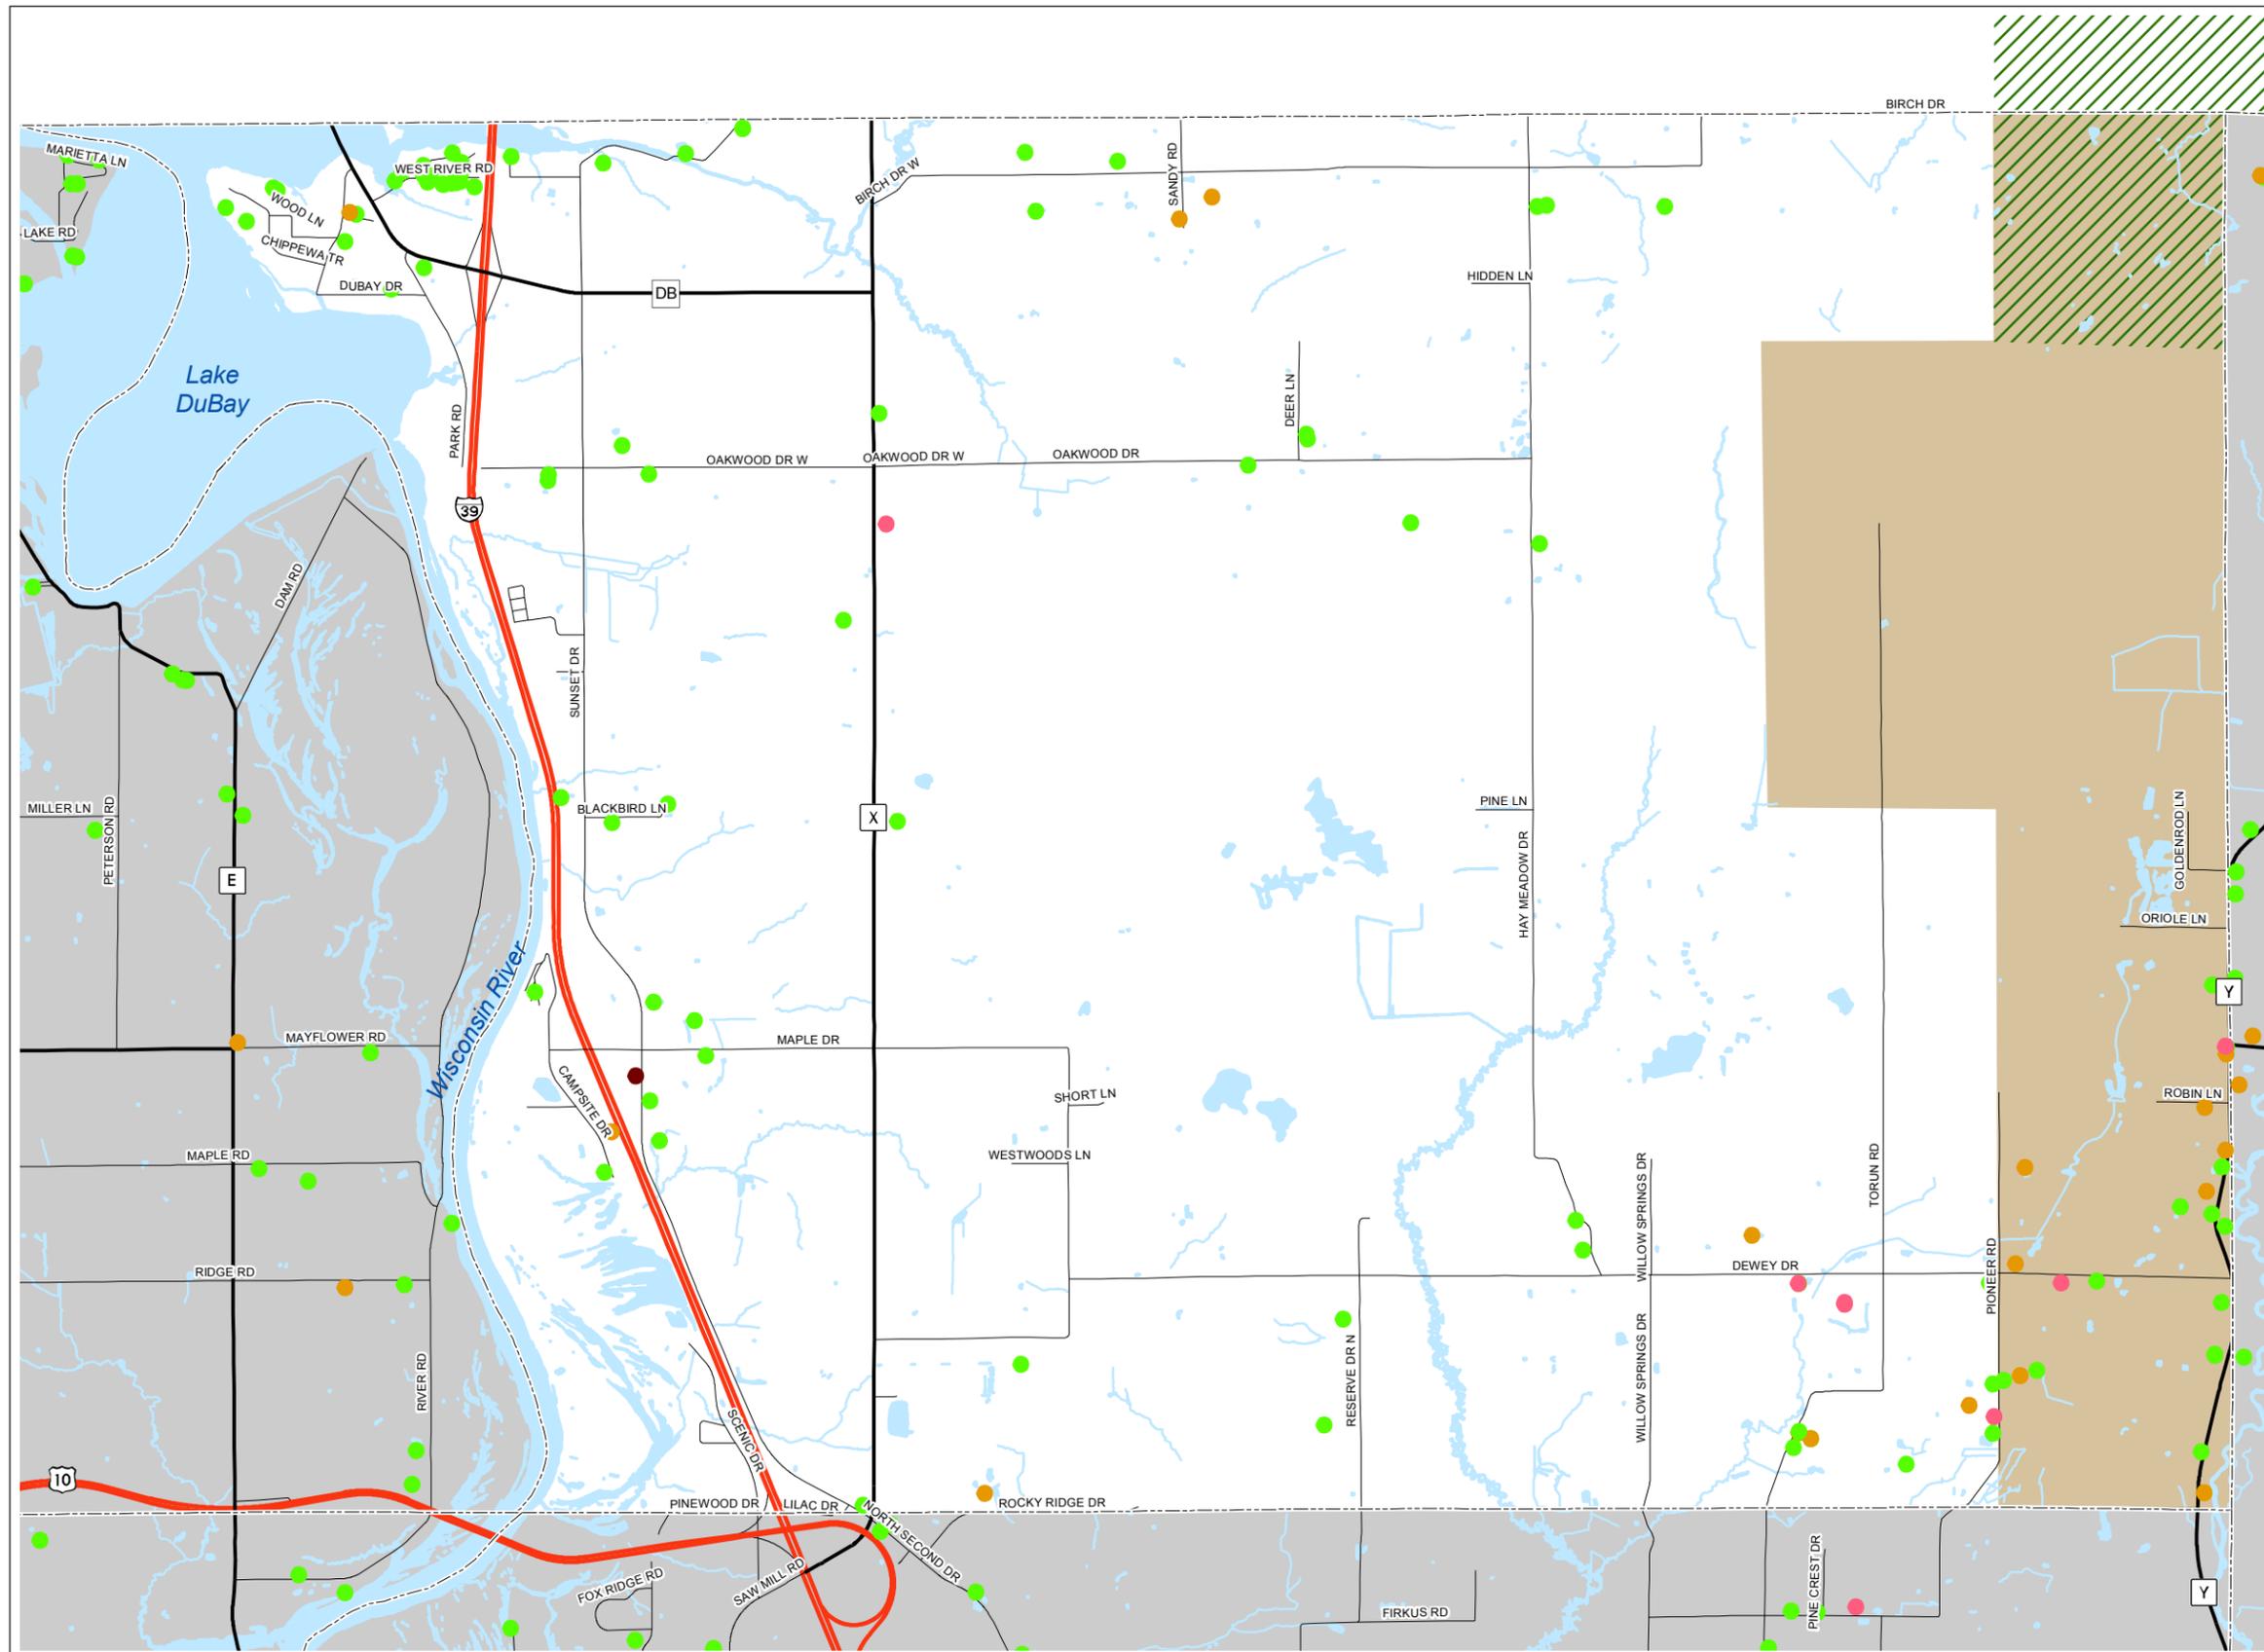

- Most Recent Nitrate Sample Results (mg/l)**
- 2.01 - 10.00
 - 10.01 - 20.00
 - 20.01 - 30.00
 - 30.01 - 82.10

- Atrazine Prohibition Area
- Groundwater Protection District C*

*District A, which is the "cone of depression" surrounding the municipal wells; District B, which is the land which lies within the five- or ten-year time-of-travel zone upgradient from municipal wells; and District C, which is the remainder of the recharge areas upgradient of District B, and includes surface water basins that may contribute to well recharge.



Source: Portage County Planning & Zoning (2009)

Adopted: July 15, 2009

Town of Dewey Comprehensive Plan



Portage County
Planning & Zoning
1462 Strongs Ave.
Stevens Point, WI 54481